

***IGEM/SR/4 Edition 3
Communication 1752***

***Variable volume gasholders storing lighter
than air gases***



*Founded 1863
Royal Charter 1929
Patron: Her Majesty the Queen*



***IGEM/SR/4 Edition 3
Communication 1752***

Variable volume gasholders storing lighter than air gases



Price Code: C5S
© The Institution of Gas Engineers and Managers
IGEM House
High Street
Kegworth
Derbyshire, DE74 2DA
Tel: 0844 375 4436
Fax: 01509 678198
Email: general@igem.org.uk

Copyright © 2011, IGEM. All rights reserved
Registered charity number 214001

All content in this publication is, unless stated otherwise, the property of IGEM. Copyright laws protect this publication. Reproduction or retransmission in whole or in part, in any manner, without the prior written consent of the copyright holder, is a violation of copyright law.

ISBN 978 1 905903 27 6

ISSN 0367 7850

Published by the Institution of Gas Engineers and Managers

Previous Publications:

Communication 1316 (1986) – 1st Edition

Communication 1624 (1996) – 2nd Edition

For information on other IGEM Standards please visit our website, www.igem.org.uk

CONTENTS

SECTION	PAGE	
1	Introduction	1
2	Scope	4
3	Legal and allied considerations	5
	• 3.1 Notification of sites	5
	• 3.2 Primary legislation	5
	• 3.2.1 Health and Safety at Work etc. Act	5
	• 3.2.2 Factories Act	5
	• 3.2.3 Control of Pollution Act	6
	• 3.2.4 Environmental Protection Act	6
	• 3.2.5 Occupier's Liability Act	6
	• 3.3 Secondary legislation	6
	• 3.3.1 Management of Health and Safety at Work Regulations	6
	• 3.3.2 Workplace (Health, Safety and Welfare) Regulations, as amended by the Health and Safety (Miscellaneous Amendments) Regulations	7
	• 3.3.3 Construction (Design and Management) Regulations	7
	• 3.3.4 Personal Protective Equipment at Work Regulations	7
	• 3.3.5 Provision and Use of Work Equipment Regulations	7
	• 3.3.6 Reporting of Injuries, Diseases and Dangerous Occurrences Regulations	7
	• 3.3.7 Confined Spaces Regulations	8
	• 3.3.8 Control of Substances Hazardous to Health Regulations	8
	• 3.3.9 Dangerous Substances and Explosive Atmospheres Regulations	8
	• 3.3.10 Work at Height Regulations	9
	• 3.3.11 Control of Lead at Work Regulations	9
	• 3.3.12 Control of Asbestos at Work Regulations	9
	• 3.3.13 Control of Noise at Work Regulations	9
	• 3.3.14 Electricity at Work Regulations	9
	• 3.3.15 Manual Handling Operations Regulations	10
	• 3.3.16 Gas Safety (Management) Regulations	10
	• 3.3.17 Notification of Installations Handling Hazardous Substances Regulations	10
	• 3.3.18 Control of Major Accident Hazard Regulations	10
	• 3.3.19 Planning (Hazardous Substances) Regulations, as amended by the Planning (Control of Major Accident Hazards) Regulations	11
4	Design	12
	• 4.1 General	12
	• 4.2 Watersealed gasholders	14
	• 4.2.1 General	15
	• 4.2.2 Prevention of ice formation in cups and above ground tanks (anti-freeze systems)	16
	• 4.3 Dry (Wiggins) and waterless (M.A.N.) gasholders	18
	• 4.4 Dry (Wiggins) gasholders	19
	• 4.5 Waterless (M.A.N.) gasholders	22

5	Entry for inspection and maintenance	27
	• 5.1 Watersealed gasholders	27
	• 5.2 Dry (Wiggins) and waterless (M.A.N.) gasholders	27
	• 5.3 Additional considerations for dry (Wiggins) gasholders	28
6	Inspections	29
	• 6.1 General	29
	• 6.2 Watersealed gasholders	29
	• 6.2.1 External inspections	29
	• 6.2.2 Internal inspections	30
	• 6.3 Dry (Wiggins) gasholders	31
	• 6.3.1 General	31
	• 6.3.2 Seal	32
	• 6.4 Waterless (M.A.N.) gasholders	32
7	Maintenance and repair	33
	• 7.1 General	33
	• 7.2 Watersealed gasholders	33
	• 7.2.1 General	33
	• 7.2.2 Routine maintenance	34
	• 7.2.3 Non-routine maintenance	35
	• 7.2.4 Other major tasks	36
	• 7.2.5 Safe operation of cup water seals	36
	• 7.3 Dry (Wiggins) gasholders	37
	• 7.4 Waterless (M.A.N.) gasholders	39
8	Electrical requirements	41
	• 8.1 General	41
	• 8.2 Watersealed gasholders	41
	• 8.2.1 Design	41
	• 8.2.2 Operation and maintenance	42
	• 8.3 Dry (Wiggins) and waterless (M.A.N.)	43
	• 8.3.1 Design	43
	• 8.3.2 Operation and maintenance	44
9	Isolation and purging	45
	• 9.1 General	45
	• 9.2 Decommissioning watersealed gasholders	45
	• 9.3 Decommissioning dry (Wiggins) gasholders	46
	• 9.4 Decommissioning waterless (M.A.N.) gasholders	46
	• 9.5 Re-commissioning all types of gasholders	47
10	Control systems and safety devices	48
	• 10.1 General	48
	• 10.2 High level control systems	49
	• 10.3 Sun stock control	50
	• 10.4 Low level control systems	50
	• 10.5 Telemetry	50
	• 10.6 Gasholder management control system	51
	• 10.7 Holder cup seal and tank monitoring systems	52

11	Demolition	53
	• 11.1 General	53
	• 11.2 Watersealed gasholders	54
	• 11.2.1 Tank water removal and disposal	54
	• 11.2.2 Guide frame dismantling	54
	• 11.2.3 Crown sheeting removal	54
	• 11.2.4 Crown support framework removal	54
	• 11.2.5 Tank access	55
	• 11.2.6 De-sludge	55
	• 11.2.7 Lifts removal	55
	• 11.2.8 Tank removal	55
	• 11.3 Dry (Wiggins) and waterless (M.A.N.) gasholders	56

APPENDIX

1	Glossary, acronyms, abbreviations, units and symbols	57
2	References	59
3	Gasholder record sheets	62
4	Calculation of heat input requirement	85
5	Procedure for emptying and filling gasholders when not in continuous use	88
6	Gasholder cupping and uncupping	90

FIGURES

1	Layout of IGEN/SR/4	2
2	Typical watersealed gasholder (column guided). Below ground tank	14
3	Typical watersealed gasholder (spiral guided). Above ground tank	14
4	Typical dry (Wiggins) gasholder	19
5	Cross-section of a typical dry (Wiggins) gasholder	20
6	Typical seal of a dry (Wiggins) gasholder	20
7	Typical waterless (M.A.N.) gasholder	22
8	Cross-section of a typical waterless (M.A.N.) gasholder	23
9	Typical tar and oil seals for waterless (M.A.N.) gasholders	24
10	Example of notice for gasholders with electric antifreeze systems	42
11	Typical gasholder height monitoring and control sensors	52
12	Calculation of cup wetted perimeter	85
13	Cup water heat loss at 2°C	86
14	Normal cupping sequence	91
15	Cupping sequence - low dip pressure	92
16	Re-dipping low cup	93

SECTION 1 : INTRODUCTION

- 1.1 This Standard supersedes IGE/SR/4 Edition 2, Communication 1624, which is obsolete.
- 1.2 This Standard has been drafted by a Panel appointed by the Institution of Gas Engineers and Managers' (IGEM's) Gas Transmission and Distribution Committee and published by the authority of the Council of IGEM.
- 1.3 This Standard applies to the design, inspection, maintenance, operation, repair, modification and demolition of gasholders. It is not retrospective but where existing practices do not comply it is recommended that such practices are reviewed and brought into line where practicable. Any deviation from this Standard needs to be subject to risk assessment and cost benefit analysis.
- 1.4 Significant amendments to Edition 2 have been made in this edition. These include:
- updating the definitions for gasholders (see IGEM/G/4)
 - revision of the requirements for electrical apparatus
 - additional information on purging
 - further guidance on control systems
 - inclusion of advice for the demolition of gasholders
 - updating of numerous references to legislation and Standards
 - revised and additional drawings of the different types of gasholders and their seals.
- 1.5 This Standard sets out general requirements for water-sealed, dry (Wiggins) and waterless (M.A.N.) gasholders. Due to the individuality of these gasholder types, however, they each have specific considerations which are made apparent in the following sections:
- design
 - entry for inspection and maintenance
 - isolation and purging
 - inspection
 - maintenance and repair
 - demolition.

The following flow chart will assist in using this Standard:

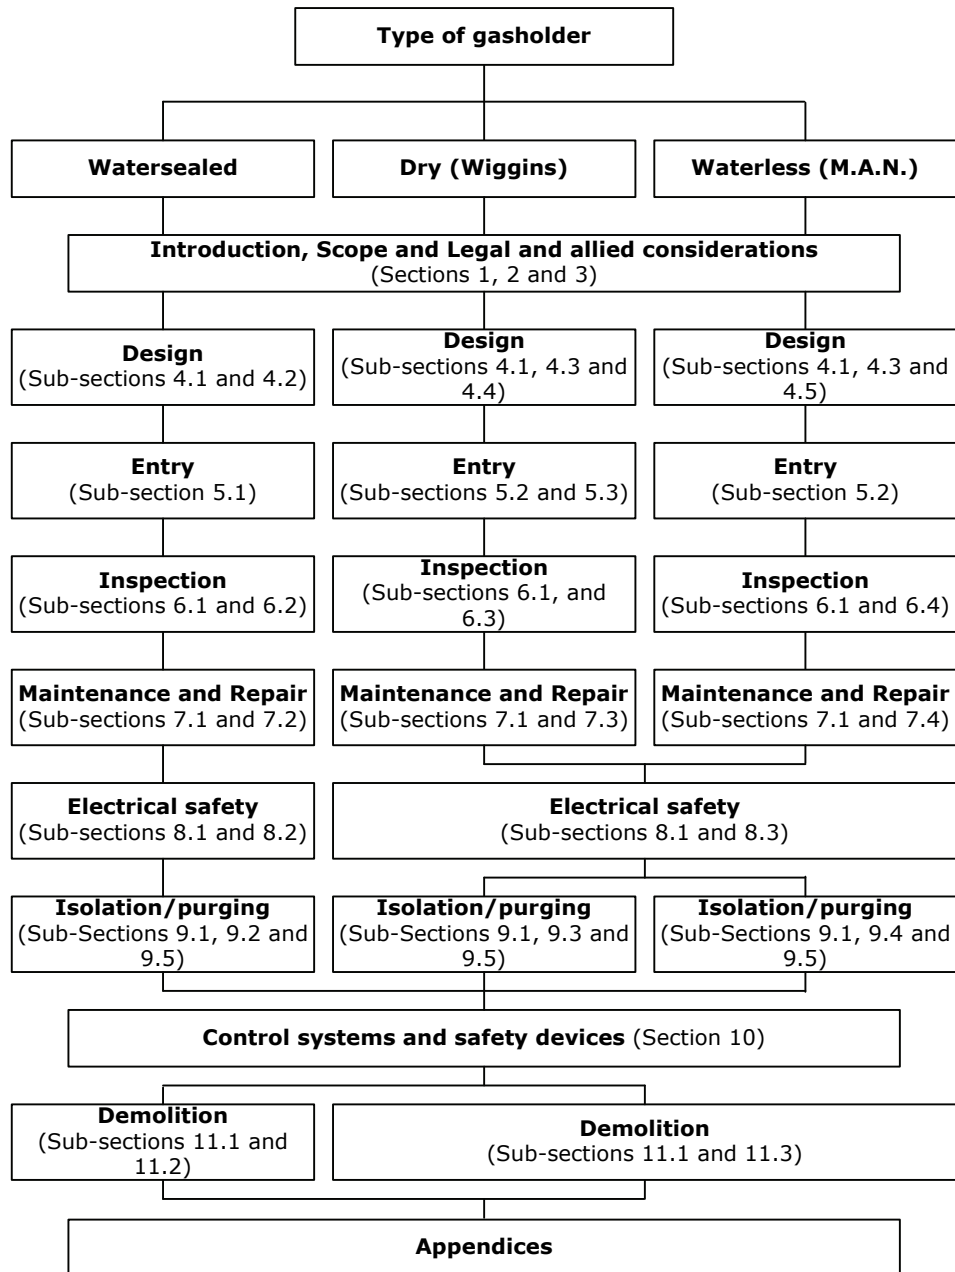


FIGURE 1 - LAYOUT OF IGEM/SR/4

- 1.6 Requirements for fixed volume gas storage storing lighter than air gases can be obtained from IGEM/SR/14.
- 1.7 This Standard makes use of the terms “must”, “shall” and “should”. Notwithstanding Sub-Section 1.9:
- the term “must” identifies a requirement by law in Great Britain (GB) at the time of publication
 - the term “shall” prescribes a requirement which, it is intended, will be complied with in full and without deviation
 - the term “should” prescribes a requirement which, it is intended, will be complied with unless, after prior consideration, deviation is considered to be acceptable.

Such terms may have different meanings when used in legislation, or Health and Safety Executive (HSE) Approved Codes of Practice (ACoPs) or Guidance, and reference needs to be made to such statutory legislation or official guidance for information on legal obligations.

- 1.8 The primary responsibility for compliance with legal duties relating to health and safety at work rests with the employer. The fact that certain employees, for example "responsible engineers" are allowed to exercise their professional judgement does not allow employers to abrogate their primary responsibilities. Employers must:
- have done everything to ensure, so far as is reasonably practicable, that there are no better protective measures that can be taken other than relying on the exercise of professional judgement by "responsible engineers"
 - have done everything to ensure, so far as is reasonably practicable, that "responsible engineers" have the skills, training, experience and personal qualities necessary for the proper exercise of professional judgement
 - have systems and procedures in place to ensure that the exercise of professional judgement by "responsible engineers" is subject to appropriate monitoring and review
 - not require "responsible engineers" to undertake tasks which would necessitate the exercise of professional judgement that is not within their competence. There should be written procedures defining the extent to which "responsible engineers" can exercise their professional judgement. When "responsible engineers" are asked to undertake tasks which deviate from this they should refer the matter for higher review.
- 1.9 Notwithstanding Sub-Section 1.7, This Standard does not attempt to make the use of any method or specification obligatory against the judgment of the responsible engineer. Where new and better techniques are developed and proved, they should be adopted without waiting for the modification of this Standard. Amendments to this Standard will be issued when necessary and their publication will be announced in the Journal of the Institution and other publications as appropriate.
- 1.10 It is now widely accepted that the majority of accidents in industry may be attributable to human as well as technical factors. People may initiate actions that cause or contribute towards accidents.
- To assist in the control of risk and proper management of these human factors, due regard should be taken of both HSG65 and HSG48.
- 1.11 Requests for interpretation of this Standard in relation to matters within their scope, but not precisely covered by the current text, should be either:
- addressed to Technical Services, IGEM, IGEM House, High Street, Kegworth, Derbyshire, DE74 2DA; or
 - emailed to technical@igem.org.uk.
- These will be submitted to the relevant Committee for consideration and advice, but in the context that the final responsibility is that of the engineer concerned. If any advice is given by or on behalf of IGEM, this does not imply acceptance of liability for the consequences and does not relieve the responsible engineer of any of his or her obligations.
- 1.12 This Standard was published in May 2011.

SECTION 2 : SCOPE

- 2.1 This Standard highlights those aspects of gasholder design, inspection, maintenance, operation, repair, modification and demolition which may put the gasholder or persons working on the gasholder, or members of the public, at risk.
- 2.2 Ancillary fittings, such as measurement controls etc., have not been covered in detail as it is considered that they come within the purview of "instrumentation controls". However, the combination of measurement and control into a logical system is discussed at some length.
- 2.3 This Standard refers to the safety of gasholders and where matters of design are mentioned, these relate to the safety features and not to the design of gasholders as a whole.
- 2.4 This Standard refers specifically to storage of gases having a density less than air. If heavier than air gases are stored in variable volume gasholders, consideration has to be given to the effects of the escape of gas during purging operations and accidental escapes of gas during operation. It is expected that the responsible engineer will identify problems and provide his or her own safe solutions.
- 2.5 All references to gas pressure are gauge pressure unless otherwise stated.
- 2.6 Italicised text is informative and does not represent formal requirements.
- 2.7 Appendices are informative and do not represent formal requirements unless specifically referenced in the main sections via the prescriptive terms "must", "shall" or "should".